


In general:

→ **Ramp structures must be integrated into the stand area!**

- Mobile ramps are not permitted.
- Presentation hangers must be accessible or a ground-level/barrier-free consultation area must be available.


Platform height: 0 – 2 cm

= permissible barrier without further measures

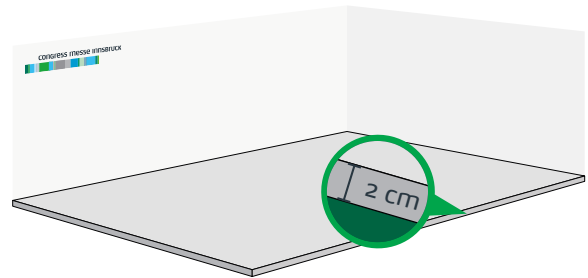



Platform height: 2 – 12 cm

- Ramp:
 - ✓ Minimum width = 1.2 m
 - ✓ Handrail height ① = 0.9 – 1 m
 - ✓ Maximum incline = 10 %
 - ✓ Free turning area after ramp exit ② with at least 1.5 m
 - ✓ Contrasting markings for entrance and exit ③
 - ✓ Surrounding ramp wedge ④:
 - Maximum incline = 30 %
 - *Alternative* → *structural barrier*

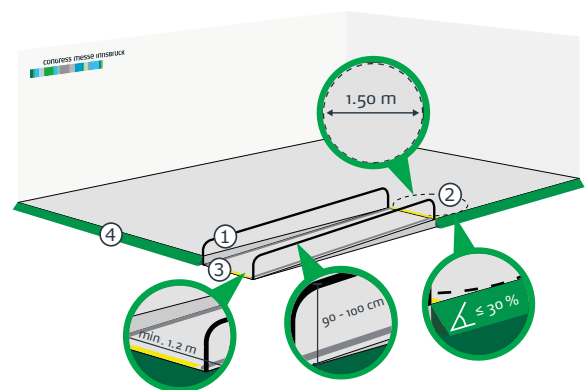


Platform height: 12 – 18 cm

- Rampe:
 - ✓ Minimum width = 1.2 m
 - ✓ Handrail height ① = 0.9 – 1 m
 - ✓ Maximum incline = 10 %
 - ✓ Free turning area after ramp exit ② with at least 1.5 m
 - ✓ Contrasting markings for entrance and exit ③
 - ✓ High-contrast marking of steps ④
- *Alternative* → *lifting platform*:
 - ✓ *Integrated into the stand area*

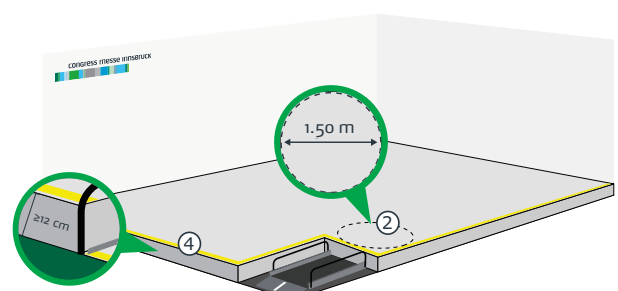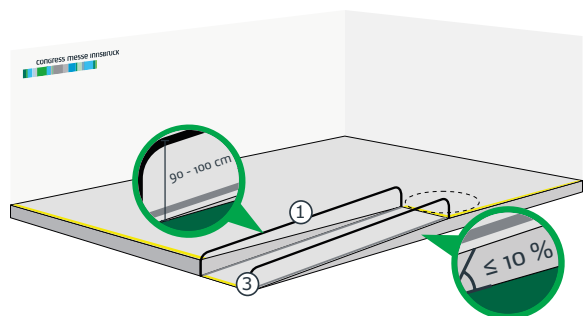


Platform height: 18 – 24 cm

- Ramp:
 - ✓ Minimum width = 1.2 m
 - ✓ Handrail height ① = 0.9 – 1 m
 - ✓ Maximum incline = 10 %
 - ✓ Free turning area after ramp exit ② with at least 1.5 m
 - ✓ Contrasting markings for entrance and exit ③
- Contrasting Marking of the front edge of the platform ④

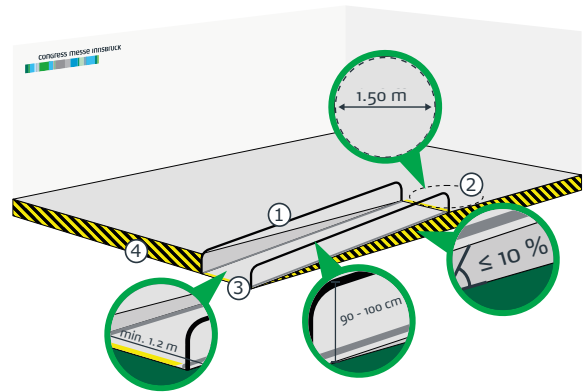

Platform height: ab 24 cm

- Stairs (step height = 12 – 18 cm):
 - ✓ Minimum width = 1.2 m
 - ✓ Handrail height ① = 0.9 – 1 m
 - ✓ Contrasting marking of the front edge of the steps ③
- Ramp:
 - ✓ Minimum width = 1.2 m
 - ✓ Handrail height ① = 0.9 – 1 m
 - ✓ Maximum incline = 10 %
 - ✓ Free turning area after ramp exit ② with at least 1.5 m
 - ✓ Contrasting markings for entrance and exit ③
- Alternative → lifting platform:
 - ✓ Integrated into the stand area

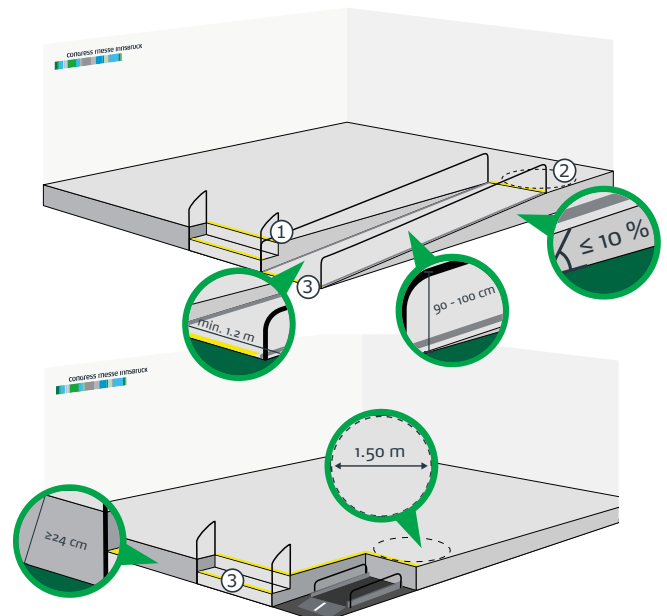

Platform height: ab 60 cm

- Stairs (step height = 12 – 18 cm):
 - ✓ Minimum width = 1.2 m
 - ✓ Handrail height ① = 0.9 – 1 m
 - ✓ Contrasting marking of the front edge of the steps ③
- Stairlift:
 - ✓ Free turning area after ramp exit ② with at least 1.5 m
 - ✓ Alternative → lifting platform
 - ✓ Integrated into the stand area
- Secure the edge with railing ① (height = 0.9 – 1 m) or other barrier!

